



Conduction-Cooled Bar Packages (CCPs), 1430-1470 nm

High Power Single-Bar Packages for Medical and Direct-Diode Applications

Based on Coherent's high efficiency InP epitaxy, Coherent 1430-1470 nm conduction-cooled laser bar packages (CCPs) provide industry leading efficiency, performance and reliability. Standard options include 20% fill factor bars rated to 35W, at wavelengths from 1430 nm to 1470 nm. Low smile configurations are available upon request. Specifications and options—including power, wavelength, and optical delivery—can be tailored to your demands.

Please contact Coherent to discuss your unique requirements.



Superior Reliability & Performance

Conduction-Cooled Bar Packages, 1430-1470 nm Features:

- High efficiency InP epitaxial technology
- 35W from a 20% fill factor bar
- Low smile options available
- ROHS compliant

Conduction-Cooled Bar Packages, 1430-1470 nm Applications:

- Medical
- Aesthetics
- Illumination
- Materials Processing

www.Coherent.com/CCP1430-1470

Conduction-Cooled Bar Packages (CCPs) , 1430-1470 nm

High Power Single-Bar Packages for Medical and Direct-Diode Applications

Device Specifications^{1,2,3}

20% fill factor bars (19 x 100 µm emitters)

Optical Output Power (W)	35
Centroid Wavelength Available ⁴ (nm)	1430 to 1470
Centroid Wavelength, Standard Options (nm)	1430 ±20 1470 ±20
Spectral Width, Standard (nm)(FWHM)	<20
Wavelength Temperature Coefficient (nm/°C)	0.53
Fill Factor (%)	20
Number of Emitters	19
Emitter Width (µm)	100
Emitter-to-Emitter Pitch (µm)	500
Fast Axis Divergence (degrees)(FWHM)	<40
Slow Axis Divergence (degrees)(FWHM)	<10
Polarization	TE
Efficiency (%)	>32
Operating Current (A)	<90
Operating Voltage (V)	<1.2
Operating Temperature	25°C
Operating Temperature Range	15 to 30°C
Storage Temperature Range	-40 to +60°C

¹ Specifications listed here are at 35W optical output power and 25°C baseplate temperature. Power-vs-current and efficiency will increase at lower temperatures and decrease at higher temperatures.

² Specifications listed here are at beginning of life. Operating current at end of life is 120% the operating current at beginning of life.

³ Please consult the factory for any needs not listed here, including the following options:

- Centroid wavelength and spectral width requirements other than listed here.
- Optical output powers other than listed here.
- Low smile options.

⁴ Contact factory for availability.

Operation Notes

Unit requires an adequate heat sink. Failure to supply an adequate heat sink will destroy the unit.

Indium foil should be used between base of diode and heatsink to ensure good thermal contact.

Torque applied to mounting screws should be controlled carefully, using a torque wrench. For 6-32 mounting screws, use 8 in-lbs (with Indium foil). For M4 mounting screws, use 9 in-lbs (with Indium foil).

ESD precautions must be taken when handling unit.

Negative current transients greater than 25 µA and/or reverse voltages >3V can destroy the unit.

A dry environment should be provided when storing or operating a device with an open diode laser facet at temperatures below the ambient dew point. Failure to do so will cause condensation on the unit and can destroy it.

Operation in excess of rated power will accelerate device aging.


Operation at higher temperatures will accelerate device aging, increase threshold current, and lower the slope efficiency.

Care should be taken to avoid back-reflections into the device. Failure to do so can destroy the unit.

Conduction-Cooled Bar Packages (CCPs) , 1430-1470 nm

High Power Single-Bar Packages for Medical and Direct-Diode Applications

Typical 1430-1470 nm Conduction-Cooled Bar Packages P-I Plots

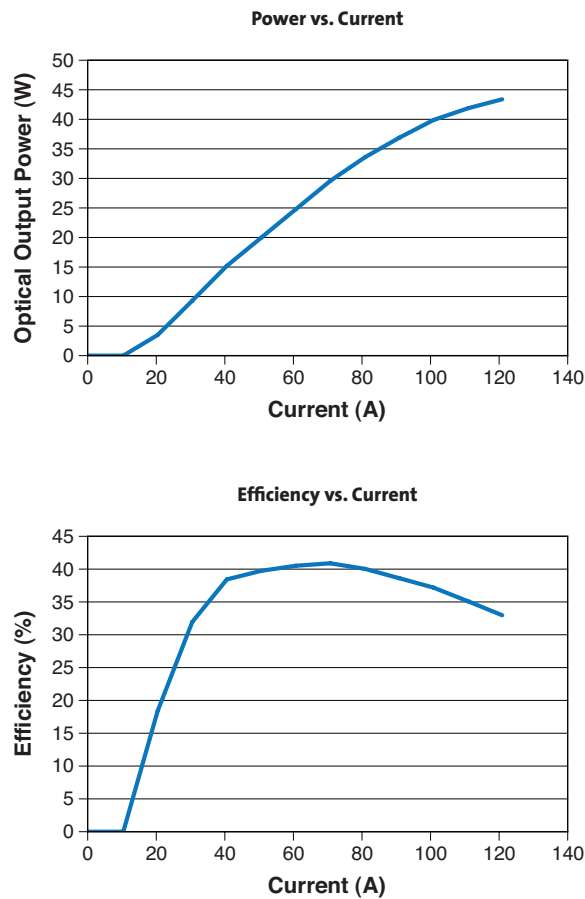




Conduction-Cooled Bar Packages (CCPs) , 1430-1470 nm

High Power Single-Bar Packages for Medical and Direct-Diode Applications


Mechanical Specifications

1430-1470 nm Unlensed CCP

Top View

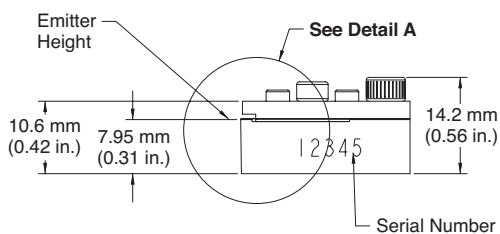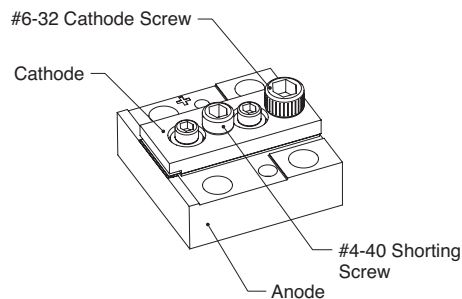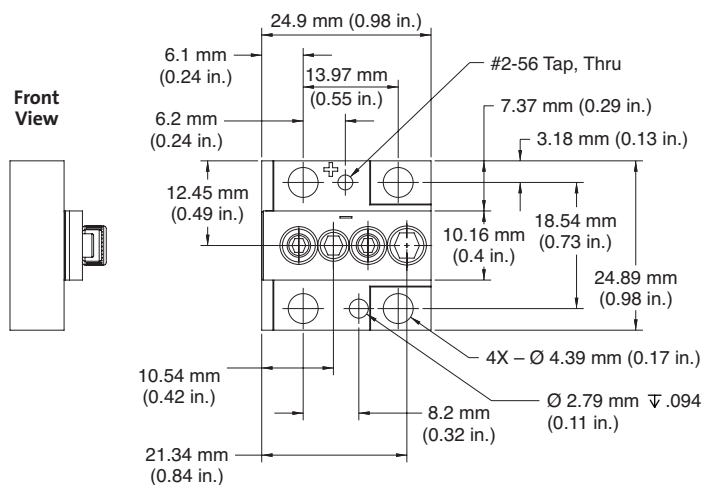

Side View



COHERENT®

www.Coherent.com

Coherent, Inc.,

5100 Patrick Henry Drive
Santa Clara, CA 95054
phone (800) 527-3786
(408) 764-4983
fax (408) 764-4646
e-mail tech.sales@Coherent.com

Benelux +31 (30) 280 6060
China +86 (10) 8215 3600
France +33 (0)1 8038 1000
Germany/Austria/
Switzerland +49 (6071) 968 333
Italy +39 (02) 31 03 951
Japan +81 (3) 5635 8700
Korea +82 (2) 460 7900
Taiwan +886 (3) 505 2900
UK/Ireland +44 (1353) 658 833

Coherent follows a policy of continuous product improvement. Specifications are subject to change without notice.

Coherent's scientific and industrial lasers are certified to comply with the Federal Regulations (21 CFR Subchapter J) as administered by the Center for Devices and Radiological Health on all systems ordered for shipment after August 2, 1976.

Coherent offers a limited warranty for all Conduction-Cooled Bar Packages. For full details of this warranty coverage, please refer to the Service section at www.Coherent.com or contact your local Sales or Service Representative.